

# CAEP

## *Submittal Documents*

### *Seismic Analysis of the Boiler SF-1500*

---



*March 29, 2019*

*For:  
WEIL-McLAIN*

Prepared By:  
Sam Salissen, ME, PE, Ph.D.

CAE Piping • 14271 Jeffrey Rd., Irvine, CA 92620 • Tel: (800) 948-1460

## *Summary*

The scope of this report is the seismic qualification, based on the structural analysis, of the boiler model SF 1500, under the seismic loads for the seismic zone 4 in the United States. The analyses are limited to the load path from the COG of the assembly to the floor and the interior parts of the boiler are not within the scope of this work.

The qualification is in accordance with the seismic design requirements of IBC 2015, ASCE 7-10 and AISC 14<sup>th</sup> edition for the seismic zone 4, for non-structural components and based on the seismic parameters used in this report.

The structural analyses carried out on the base frame assembly and based on the safety factors reported in section 5.4, the design requirements of AISC, is met in all the analyses performed in this report.

It is concluded that the design of the main frame and seismic stands meets the design requirements of IBC 2015, ASCE 7-10 and ASME BPVC and AISC standards. This conclusion is contingent to the accuracy of the SolidWorks model and other input data provided by WEIL-McLAIN (WM) and used to build the FE models and set up the analyses (material, COG,...) appended in Appendix 1.

## ***Revision History***

<b>Rev</b>	<b>Date</b>	<b>Scope of the revision</b>	<b>Created by</b>
A	02/23/2018	First Issue	Sam Salissen
B	03/29/2019	The model is updated	Sam Salissen

# Table of Contents

1	Introduction .....	6
1.1	Scope .....	6
2	Assumptions and open issues .....	6
3	Requirements and Prerequisites.....	7
3.1	Stress criteria.....	7
3.2	Loads .....	7
4	Analyses' model .....	9
4.1	The extent of the model.....	9
4.2	Material data.....	9
5	Stress Analyses .....	10
5.1	Analysis of assembly: Load Case 1 .....	10
5.2	Analysis of assembly: Load Case 2 .....	11
5.3	Analysis of assembly: Load Case 3 .....	13
5.3.1	Anchor Bolts .....	14
5.4	Results Evaluation.....	14
6	Conclusion .....	14
7	References .....	15

## **APPENDICES**

*APPENDIX 1*- Drawing with COG markup

*APPENDIX 2*- Anchor Bolt Calculation Report

# ***1 Introduction***

## ***1.1 Scope***

The scope of this report is the seismic qualification, based on the structural analysis, of the boiler, model SF 1500, under the seismic loads for the seismic zone 4 in the states. The analyses are limited to the load path from the COG of the assembly to the floor and the interior parts of the boiler are not within the scope of this work. The qualification is in accordance with the design requirements of IBC 2015, ASCE 7-10 and AISC.

## ***2 Assumptions and open issues***

In this chapter, assumptions and open issues are presented in two categories. The definition of each is presented below.

***Open issues-*** Is defined as issues that must be solved, otherwise the analysis cannot be completed.

***Key assumption-*** Is defined as assumptions that may have noticeable impact on the analysis results.

### **2.1 Open Issues**

- No open issues exist.

### **2.2 Key Assumptions**

No fabrication drawing of the parts and assembly were provided and the analyses are based on the SolidWorks model that is provided by WM and no responsibility of the accuracy of the model with respect to the actual assembly will be taken by the author of this report.

- The weight and the location of the center of the gravity of the boiler assembly are estimated and provided by WM, Appendix 1.
- It is assumed that the material of the base frame and the top plate are S235JR .
- It is assumed that the welds have at least the same strength as the base material (Weld strength  $F_{EXX} = 70 \text{ksi} > 54 \text{ksi}$  for base material) based on ASME allowable stress in welds under shear and tension is  $0.3 * \text{tensile strength} = 21000 \text{psi}$ . In this case it is lower than the allowable stress of the in the members (AISC). So no weld analysis will be performed in this work.

### 3 Requirements and Prerequisites

#### 3.1 Stress criteria

The seismic loads are calculated based on the IBC 2015 code. The detail of the used parameters and the calculations are as follows. Seismic analyses are performed (using FEM) based on ASD approach of the AISC 14 edition & ASCE 7-10 for the steel parts and LRFD for the anchorage calculations.


#### 3.2 Loads

The following inputs are used for the weight of the boilers.

Boiler Model Number	Input	Gross Output	Net Rating	Combustion Efficiency	Thermal Efficiency	Boiler Water Content	Vent/Air Pipe Size	Stack/vent flow rate	Boiler weight (pounds)		
	Btuh (Note 1)	Btuh (Note 1)	Btuh (Note 2)	% (Note 3)	% (Note 4)	Gallons	Inches (Note 5)	scfm (Note 6)	Dry weight (no water)	Operating weight (filled)	Shipping weight
SF1000	1,000,000	958,000	833,000	96.1	95.8	13	6, 8 or 10	279	865	975	1,130
SF1500	1,500,000	1,437,000	1,250,000	95.9	95.8	19	8 or 10	418	1,050	1,210	1,310
SF2000	2,000,000	1,906,000	1,657,000	95.8	95.3	25	8 or 10	558	1,250	1,460	1,510

Three load cases are considered in this report, the analyses are based on the worst load combinations specified in ASCE 7-10. The following parameters are used in calculation of the seismic loads as follows:

- 1- Load case 1: Used for the analyses of the steel parts



14271 Jeffrey Rd.  
Irvine, CA 92602  
PH (949) 923 9073 FX (949) 254 7184  
[www.caepiping.com](http://www.caepiping.com)  
"CALL US - TO SET THINGS RIGHT"

**JOB NAME:** SA-SF 1500  
**CUSTOMER:** WEIL-McLAIN  
DATE: 2/23/2019


**SEISMIC CALCULATION WORKSHEET**  
BUILDING CODE: IBC-2012 / 2015  
SEISMIC DESIGN: S<sub>ds</sub> = 2, I<sub>p</sub> = 1, a<sub>p</sub> = 1, R<sub>p</sub> = 2.5, Ω<sub>0</sub> = 2.0  
BLDG. ELEVATION: h = 40 ft  
/EQUIP. LOCATION: z = 40 ft  
\*\* Assume worst case location  
a<sub>p</sub>, R<sub>p</sub>, Ω<sub>0</sub> per ASCE 7-10

**EQUIPMENT TAG:** SLIM FIT 1500

**APPLIED SEISMIC FORCE/CALCULATIONS:**  
 $F_p / W_p = 0.96g$ ;  $F_{p, min} / W_p = 0.3$ ;  $F_{p, max} / W_p = 0.60$ ;  $F_{p, min} / W_p = 1.6 \times S_{ds} \times I_p = 3.20$   
 $F_{p, h}$  = Applied Lateral Seismic Force = 1.0 x 0.96g x W<sub>p</sub> = 1162 lbs. \*WORST CASE  
 $F_{p, v}$  = Vertical component of seismic force = 1.0 x 0.2 x S<sub>ds</sub> x W<sub>p</sub> = 484 lbs. \*WORST CASE  
 $F_v$  = Vertical total load = F<sub>p, v</sub> - 0.9\*W<sub>p</sub> = 605 lbs.

**ANCHORAGE TO CONCRETE** SHT. NUMBER: 1 OF 1  
 ( 0.9 DL + 1.00 E )

- 2- Load case 2: Used for the analyses of the steel parts



14271 Jeffrey Rd.  
Irvine, CA 92602  
PH (949) 923 9073 FX (949) 254 7184  
[www.caepiping.com](http://www.caepiping.com)  
"CALL US - TO SET THINGS RIGHT"

**JOB NAME:** SA-SF 1500  
**CUSTOMER:** WEIL-McLAIN  
DATE: 2/23/2019

**SEISMIC CALCULATION WORKSHEET**  
BUILDING CODE: IBC-2012 / 2015  
SEISMIC DESIGN: S<sub>ds</sub> = 2, I<sub>p</sub> = 1, a<sub>p</sub> = 1, R<sub>p</sub> = 2.5, Ω<sub>0</sub> = 2.0  
BLDG. ELEVATION: h = 40 ft  
/EQUIP. LOCATION: z = 40 ft  
\*\* Assume worst case location  
a<sub>p</sub>, R<sub>p</sub>, Ω<sub>0</sub> per ASCE 7-10

**EQUIPMENT TAG:** SLIM FIT 1500

**APPLIED SEISMIC FORCE/CALCULATIONS:**  
 $F_p / W_p = 0.96g$ ;  $F_{p, min} / W_p = 0.3$ ;  $F_{p, max} / W_p = 0.60$ ;  $F_{p, min} / W_p = 1.6 \times S_{ds} \times I_p = 3.20$   
 $F_{p, h}$  = Applied Lateral Seismic Force = 1.0 x 0.96g x W<sub>p</sub> = 1162 lbs. \*WORST CASE  
 $F_{p, v}$  = Vertical component of seismic force = 1.0 x 0.2 x S<sub>ds</sub> x W<sub>p</sub> = 484 lbs. \*WORST CASE  
 $F_v$  = Vertical total load = F<sub>p, v</sub> - 0.9\*W<sub>p</sub> = 668 lbs.

**ANCHORAGE TO CONCRETE** SHT. NUMBER: 1 OF 1  
 ( 1.2 DL + 1.00 E )

### 5.3.1 Anchor Bolts

Hilti KBZ anchor bolts, 3/8" (2 3/4" embedment), are used to anchor the base plates to the floor. The maximum reaction loads at the location of the joints are extracted from the FE-analyses (load case 3 above). The detail of the anchor bolt calcs are provided in Appendix 3. The minimum concrete thickness of 5" and PSI rating of 3,000 psi are considered in the analyses).

Table-3: Reaction loads in the base plate

Reaction forces [lbf]			Reaction moments [lbf-ft]		
FX	FY	FZ	MX	MY	MZ
20	910	995	530	38	53

### 5.4 Results Evaluation

Minimum required strength specified in ASCE (LRFD design approach) is obtained in the analyses of the assembly carried out in sections 5.1 to 5.4, (minimum safety factor of 1 for LRFD load). The stresses reported in section 5 are the local stresses and the average stress through the thickness of the members are much lower and that can be shown by stress linearization through the thickness. However, since even the maximum local peak stresses don't exceed the allowable values, the stress linearization work is skipped here.

## 6 Conclusion

Seismic analysis of the boiler, model SF 1500, is carried out in this report and based on the safety factors reported in section 5.4, minimum required strength factor is obtained in all the analyses performed in this report.

It is concluded that the design of the structure of the boiler SF-1500 meets the design requirements of AISC, ASCE7-10 and IBC 2012 standards.




## ***7 References***

[1]- IBC 2012.

[2]- AISC 14<sup>th</sup> Edition.

[3]- ASCE 7-10.

APPENDIX 1- Drawing with COG markup

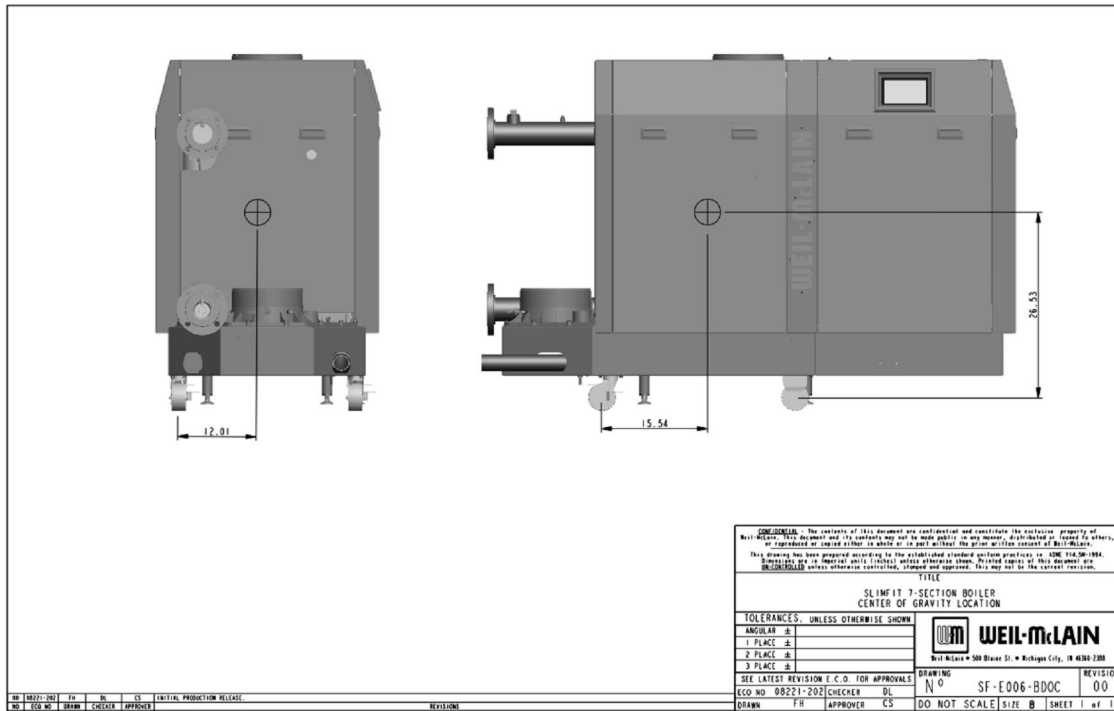

**CONFIDENTIAL** - The contents of this document are confidential and constitute the exclusive property of Weil-McLain. This document and its contents may not be made public, in any manner, distributed or passed to others, or reproduced or copied without the written consent of Weil-McLain.

This drawing has been prepared according to the established standard system practices in COME FIVE 500-1000. Dimensions are in Imperial units (inches) unless otherwise shown. Printed copies of this document are UNCONTROLLED unless otherwise controlled, stamped and approved. This may not be the correct revision.

**TITLE**  
SLIMFIT 7-SECTION BOILER  
CENTER OF GRAVITY LOCATION

**TOLERANCES, UNLESS OTHERWISE SHOWN**

ANGULAR	±
1 PLACE	±
2 PLACE	±
3 PLACE	±

SEE LATEST REVISION (C.O. FOR APPROVALS)  
ECO NO 08221-202

CHECKER	DL	DRAWING	N <sup>0</sup>	REVISION
DRAWN	FR	APPROVER	CS	SF-E006-BDOC
DO NOT SCALE				00

WEIL-McLAIN  
Weil-McLain • 500 Beaver St. • Michigan City, IN 46360-2300

NO	REV	BY	DATE	INITIAL PRODUCTION RELEASE
NO	1	FR		

REVISIONS

*Appendix 2- Anchor Bolt Calculation*



[www.hilti.us](http://www.hilti.us)

Company: CAE PIPING INC.  
 Specifier: SAM SALISSEN  
 Address:  
 Phone | Fax: |  
 E-Mail: SSALISSEN@CAEPIPING.COM

Page: 2  
 Project: ANCHOR SF1500  
 Sub-Project | Pos. No.: FOR WEIL-McLAIN  
 Date: 3/31/2019

## 2 Load case/Resulting anchor forces


Load case: Design loads

### Anchor reactions [lb]

Tension force: (+Tension, -Compression)

Anchor	Tension force	Shear force	Shear force x	Shear force y
1	118	199	37	196
2	97	262	37	259
3	795	198	-27	196
4	775	261	-27	259

max. concrete compressive strain: 0.07 [%]  
 max. concrete compressive stress: 324 [psi]  
 resulting tension force in (x/y)=(-0.057/1.898): 1785 [lb]  
 resulting compression force in (x/y)=(0.448/-3.760): 790 [lb]

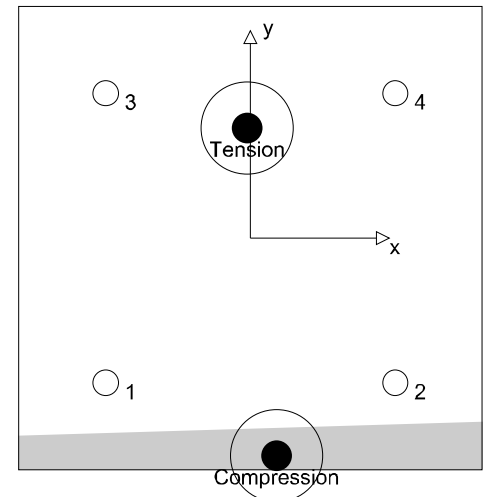

## 3 Tension load

	Load $N_{ua}$ [lb]	Capacity $\phi N_n$ [lb]	Utilization $\beta_N = N_{ua}/\phi N_n$	Status
Steel Strength*	795	4875	17	OK
Pullout Strength*	795	1685	48	OK
Concrete Breakout Strength**	1785	3607	50	OK

\* anchor having the highest loading \*\*anchor group (anchors in tension)

### 3.1 Steel Strength

$N_{sa}$  = ESR value refer to ICC-ES ESR-1917  
 $\phi N_{sa} \geq N_{ua}$  ACI 318-14 Table 17.3.1.1

#### Variables

$A_{se,N}$ [in. <sup>2</sup> ]	$f_{uta}$ [psi]
0.05	125000

#### Calculations

$N_{sa}$ [lb]
6500

#### Results

$N_{sa}$ [lb]	$\phi_{steel}$	$\phi_{nonductile}$	$\phi N_{sa}$ [lb]	$N_{ua}$ [lb]
6500	0.750	1.000	4875	795

www.hilti.us

Company: CAE PIPING INC.  
 Specifier: SAM SALISSEN  
 Address:  
 Phone | Fax: |  
 E-Mail: SSALISSEN@CAEPIPING.COM

Page: 3  
 Project: ANCHOR SF1500  
 Sub-Project | Pos. No.: FOR WEIL-McLAIN  
 Date: 3/31/2019

### 3.2 Pullout Strength

$$N_{pn,f_c} = N_{p,2500} \lambda_a \sqrt{\frac{f_c}{2500}} \quad \text{refer to ICC-ES ESR-1917}$$

$$\phi N_{pn,f_c} \geq N_{ua} \quad \text{ACI 318-14 Table 17.3.1.1}$$

#### Variables

$f_c$ [psi]	$\lambda_a$	$N_{p,2500}$ [lb]
3000	1.000	3155

#### Calculations

$$\frac{\sqrt{\frac{f_c}{2500}}}{1.095}$$

#### Results

$N_{pn,f_c}$ [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi N_{pn,f_c}$ [lb]	$N_{ua}$ [lb]
3456	0.650	0.750	1.000	1685	795

### 3.3 Concrete Breakout Strength

$$N_{cbg} = \left( \frac{A_{Nc}}{A_{Nc0}} \right) \psi_{ec,N} \psi_{ed,N} \psi_{c,N} \psi_{cp,N} N_b \quad \text{ACI 318-14 Eq. (17.4.2.1b)}$$

$$\phi N_{cbg} \geq N_{ua} \quad \text{ACI 318-14 Table 17.3.1.1}$$

$$A_{Nc} \text{ see ACI 318-14, Section 17.4.2.1, Fig. R 17.4.2.1(b)}$$

$$A_{Nc0} = 9 h_{ef}^2 \quad \text{ACI 318-14 Eq. (17.4.2.1c)}$$

$$\psi_{ec,N} = \left( \frac{1}{1 + \frac{2 e_{c,N}}{3 h_{ef}}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.4)}$$

$$\psi_{ed,N} = 0.7 + 0.3 \left( \frac{c_{a,min}}{1.5 h_{ef}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.5b)}$$

$$\psi_{cp,N} = \text{MAX} \left( \frac{c_{a,min}}{c_{ac}}, \frac{1.5 h_{ef}}{c_{ac}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.7b)}$$

$$N_b = k_c \lambda_a \sqrt{f_c} h_{ef}^{1.5} \quad \text{ACI 318-14 Eq. (17.4.2.2a)}$$

#### Variables

$h_{ef}$ [in.]	$e_{c1,N}$ [in.]	$e_{c2,N}$ [in.]	$c_{a,min}$ [in.]	$\psi_{c,N}$
2.750	0.057	1.898	10.000	1.000

$c_{ac}$ [in.]	$k_c$	$\lambda_a$	$f_c$ [psi]
4.125	17	1.000	3000

#### Calculations

$A_{Nc}$ [in. <sup>2</sup> ]	$A_{Nc0}$ [in. <sup>2</sup> ]	$\psi_{ec1,N}$	$\psi_{ec2,N}$	$\psi_{ed,N}$	$\psi_{cp,N}$	$N_b$ [lb]
175.56	68.06	0.986	0.685	1.000	1.000	4246

#### Results

$N_{cbg}$ [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi N_{cbg}$ [lb]	$N_{ua}$ [lb]
7399	0.650	0.750	1.000	3607	1785

## 4 Shear load

	Load $V_{ua}$ [lb]	Capacity $\phi V_n$ [lb]	Utilization $\beta_V = V_{ua}/\phi V_n$	Status
Steel Strength*	262	1466	18	OK
Steel failure (with lever arm)*	N/A	N/A	N/A	N/A
Pryout Strength**	910	13065	7	OK
Concrete edge failure in direction y+**	913	3599	26	OK

\* anchor having the highest loading \*\*anchor group (relevant anchors)

### 4.1 Steel Strength

$V_{sa,eq}$  = ESR value refer to ICC-ES ESR-1917  
 $\phi V_{steel} \geq V_{ua}$  ACI 318-14 Table 17.3.1.1

#### Variables

$$\frac{A_{se,V} [\text{in.}^2]}{0.05} \quad \frac{f_{uta} [\text{psi}]}{125000}$$

#### Calculations

$$\frac{V_{sa,eq} [\text{lb}]}{2255}$$

#### Results

$V_{sa,eq}$ [lb]	$\phi_{steel}$	$\phi_{nonductile}$	$\phi V_{sa}$ [lb]	$V_{ua}$ [lb]
2255	0.650	1.000	1466	262

### 4.2 Pryout Strength

$$V_{cpg} = k_{cp} \left[ \left( \frac{A_{Nc}}{A_{Nc0}} \right) \psi_{ec,N} \psi_{ed,N} \psi_{c,N} \psi_{cp,N} N_b \right] \quad \text{ACI 318-14 Eq. (17.5.3.1b)}$$

$$\phi V_{cpg} \geq V_{ua} \quad \text{ACI 318-14 Table 17.3.1.1}$$

$$A_{Nc} \text{ see ACI 318-14, Section 17.4.2.1, Fig. R 17.4.2.1(b)}$$

$$A_{Nc0} = 9 h_{ef}^2 \quad \text{ACI 318-14 Eq. (17.4.2.1c)}$$

$$\psi_{ec,N} = \left( \frac{1}{1 + \frac{2 e_N}{3 h_{ef}}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.4)}$$

$$\psi_{ed,N} = 0.7 + 0.3 \left( \frac{c_{a,min}}{1.5 h_{ef}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.5b)}$$

$$\psi_{cp,N} = \text{MAX} \left( \frac{c_{a,min}}{c_{ac}}, \frac{1.5 h_{ef}}{c_{ac}} \right) \leq 1.0 \quad \text{ACI 318-14 Eq. (17.4.2.7b)}$$

$$N_b = k_c \lambda_a \sqrt{f_c} h_{ef}^{1.5} \quad \text{ACI 318-14 Eq. (17.4.2.2a)}$$

#### Variables

$$\frac{k_{cp}}{2} \quad \frac{h_{ef} [\text{in.}]}{2.750} \quad \frac{e_{c1,N} [\text{in.}]}{0.699} \quad \frac{e_{c2,N} [\text{in.}]}{0.015} \quad \frac{c_{a,min} [\text{in.}]}{10.000}$$

$$\frac{\psi_{c,N}}{1.000} \quad \frac{c_{ac} [\text{in.}]}{4.125} \quad \frac{k_c}{17} \quad \frac{\lambda_a}{1.000} \quad \frac{f_c [\text{psi}]}{3000}$$

#### Calculations

$A_{Nc}$ [in. <sup>2</sup> ]	$A_{Nc0}$ [in. <sup>2</sup> ]	$\psi_{ec1,N}$	$\psi_{ec2,N}$	$\psi_{ed,N}$	$\psi_{cp,N}$	$N_b$ [lb]
175.56	68.06	0.855	0.996	1.000	1.000	4246

#### Results

$V_{cpg}$ [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi V_{cpg}$ [lb]	$V_{ua}$ [lb]
18664	0.700	1.000	1.000	13065	910

### 4.3 Concrete edge failure in direction y+

$V_{cbg} = \left( \frac{A_{Vc}}{A_{Vc0}} \right) \psi_{ec,V} \psi_{ed,V} \psi_{c,V} \psi_{h,V} \psi_{parallel,V} V_b$	ACI 318-14 Eq. (17.5.2.1b)
$\phi V_{cbg} \geq V_{ua}$	ACI 318-14 Table 17.3.1.1
$A_{Vc}$ see ACI 318-14, Section 17.5.2.1, Fig. R 17.5.2.1(b)	
$A_{Vc0} = 4.5 c_{a1}^2$	ACI 318-14 Eq. (17.5.2.1c)
$\psi_{ec,V} = \left( \frac{1}{1 + \frac{2e_v}{3c_{a1}}} \right) \leq 1.0$	ACI 318-14 Eq. (17.5.2.5)
$\psi_{ed,V} = 0.7 + 0.3 \left( \frac{c_{a2}}{1.5c_{a1}} \right) \leq 1.0$	ACI 318-14 Eq. (17.5.2.6b)
$\psi_{h,V} = \sqrt{\frac{1.5c_{a1}}{h_a}} \geq 1.0$	ACI 318-14 Eq. (17.5.2.8)
$V_b = \left( 7 \left( \frac{l_e}{d_a} \right)^{0.2} \sqrt{d_a} \right) \lambda_a \sqrt{f'_c} c_{a1}^{1.5}$	ACI 318-14 Eq. (17.5.2.2a)

#### Variables

$c_{a1}$ [in.]	$c_{a2}$ [in.]	$e_{cV}$ [in.]	$\psi_{c,V}$	$h_a$ [in.]
6.667	10.000	0.348	1.000	5.000
$l_e$ [in.]	$\lambda_a$	$d_a$ [in.]	$f'_c$ [psi]	$\psi_{parallel,V}$
2.750	1.000	0.375	3000	1.000

#### Calculations

$A_{Vc}$ [in. <sup>2</sup> ]	$A_{Vc0}$ [in. <sup>2</sup> ]	$\psi_{ec,V}$	$\psi_{ed,V}$	$\psi_{h,V}$	$V_b$ [lb]
125.00	200.00	0.966	1.000	1.414	6020

#### Results

$V_{cbg}$ [lb]	$\phi_{concrete}$	$\phi_{seismic}$	$\phi_{nonductile}$	$\phi V_{cbg}$ [lb]	$V_{ua}$ [lb]
5142	0.700	1.000	1.000	3599	913

### 5 Combined tension and shear loads

$\beta_N$	$\beta_V$	$\zeta$	Utilization $\beta_{NV}$ [%]	Status
0.495	0.254	5/3	42	OK

$$\beta_{NV} = \beta_N^{\zeta} + \beta_V^{\zeta} \leq 1$$

### 6 Warnings

- Load re-distributions on the anchors due to elastic deformations of the anchor plate are not considered. The anchor plate is assumed to be sufficiently stiff, in order not to be deformed when subjected to the loading! Input data and results must be checked for agreement with the existing conditions and for plausibility!
- Condition A applies when supplementary reinforcement is used. The  $\Phi$  factor is increased for non-steel Design Strengths except Pullout Strength and Pryout strength. Condition B applies when supplementary reinforcement is not used and for Pullout Strength and Pryout Strength. Refer to your local standard.
- Refer to the manufacturer's product literature for cleaning and installation instructions.
- Checking the transfer of loads into the base material and the shear resistance are required in accordance with ACI 318 or the relevant standard!
- An anchor design approach for structures assigned to Seismic Design Category C, D, E or F is given in ACI 318-14, Chapter 17, Section 17.2.3.4.3 (a) that requires the governing design strength of an anchor or group of anchors be limited by ductile steel failure. If this is NOT the case, the connection design (tension) shall satisfy the provisions of Section 17.2.3.4.3 (b), Section 17.2.3.4.3 (c), or Section 17.2.3.4.3 (d). The connection design (shear) shall satisfy the provisions of Section 17.2.3.5.3 (a), Section 17.2.3.5.3 (b), or Section 17.2.3.5.3 (c).
- 
- Hilti post-installed anchors shall be installed in accordance with the Hilti Manufacturer's Printed Installation Instructions (MPII), Reference ACI 318-14, Section 17.8.1.





**www.hilti.us**

**Profis Anchor 2.7.1**

Company: CAE PIPING INC.  
Specifier: SAM SALISSEN  
Address:  
Phone | Fax: |  
E-Mail: SSALISSEN@CAEPIPING.COM

Page: 6  
Project: ANCHOR SF1500  
Sub-Project | Pos. No.: FOR WEIL-McLAIN  
Date: 3/31/2019

---

**Fastening meets the design criteria!**

[www.hilti.us](http://www.hilti.us)

Company: CAE PIPING INC.  
 Specifier: SAM SALISSEN  
 Address:  
 Phone | Fax: |  
 E-Mail: SSALISSEN@CAEPIPING.COM

Page: 7  
 Project: ANCHOR SF1500  
 Sub-Project | Pos. No.: FOR WEIL-McLAIN  
 Date: 3/31/2019


## 7 Installation data

Anchor plate, steel: -  
 Profile: Round HSS, Steel pipe (AISC); 4.500 x 4.500 x 0.237 in.  
 Hole diameter in the fixture:  $d_f = 0.438$  in.  
 Plate thickness (input): 0.500 in.  
 Recommended plate thickness: not calculated  
 Drilling method: Hammer drilled  
 Cleaning: Manual cleaning of the drilled hole according to instructions for use is required.

Anchor type and diameter: Kwik Bolt TZ - CS 3/8 (2 3/4)  
 Installation torque: 25.000 ft.lb  
 Hole diameter in the base material: 0.375 in.  
 Hole depth in the base material: 3.375 in.  
 Minimum thickness of the base material: 5.000 in.

### 7.1 Recommended accessories

Drilling	Cleaning	Setting
<ul style="list-style-type: none"> <li>Suitable Rotary Hammer</li> <li>Properly sized drill bit</li> </ul>	<ul style="list-style-type: none"> <li>Manual blow-out pump</li> </ul>	<ul style="list-style-type: none"> <li>Torque wrench</li> <li>Hammer</li> </ul>

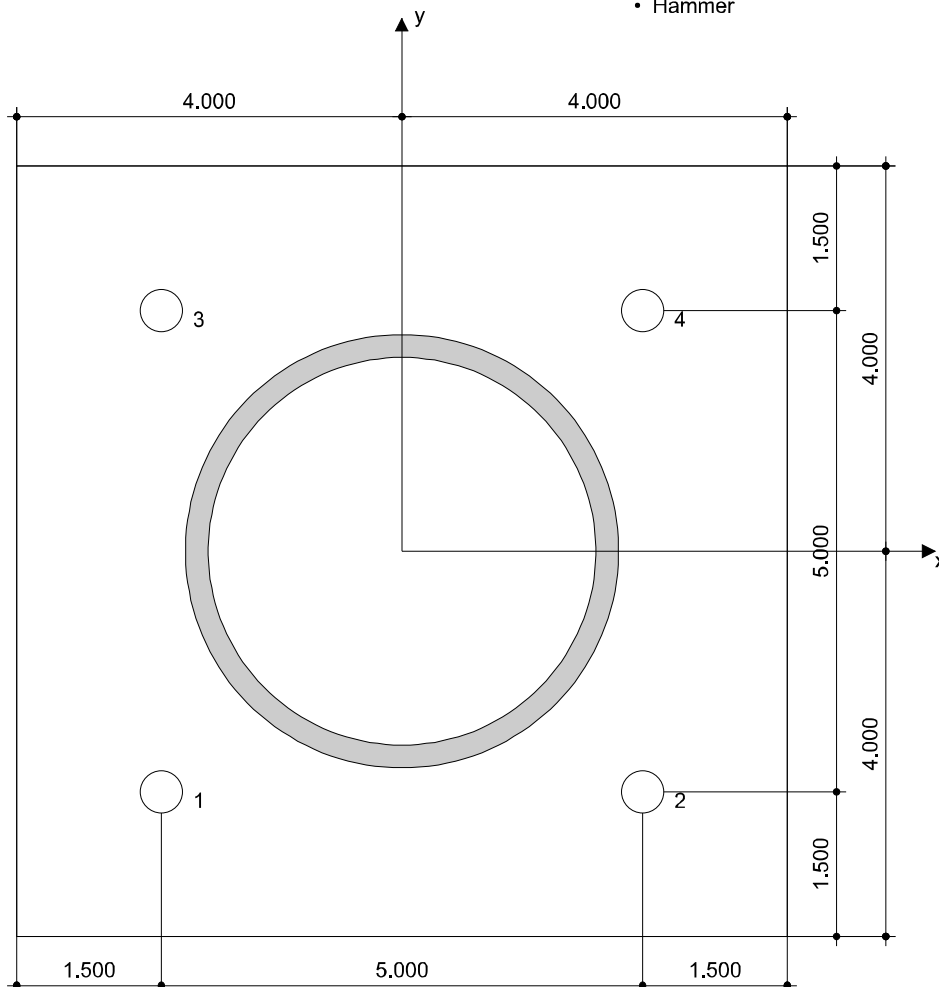

### Coordinates Anchor in.

Anchor	x	y	C <sub>-x</sub>	C <sub>+x</sub>	C <sub>-y</sub>	C <sub>+y</sub>
1	-2.500	-2.500	10.000	15.000	10.000	15.000
2	2.500	-2.500	15.000	10.000	10.000	15.000
3	-2.500	2.500	10.000	15.000	15.000	10.000
4	2.500	2.500	15.000	10.000	15.000	10.000

**www.hilti.us**

Company: CAE PIPING INC.  
Specifier: SAM SALISSEN  
Address:  
Phone | Fax: |  
E-Mail: SSALISSEN@CAEPIPING.COM

Page: 8  
Project: ANCHOR SF1500  
Sub-Project | Pos. No.: FOR WEIL-McLAIN  
Date: 3/31/2019

## 8 Remarks; Your Cooperation Duties

- Any and all information and data contained in the Software concern solely the use of Hilti products and are based on the principles, formulas and security regulations in accordance with Hilti's technical directions and operating, mounting and assembly instructions, etc., that must be strictly complied with by the user. All figures contained therein are average figures, and therefore use-specific tests are to be conducted prior to using the relevant Hilti product. The results of the calculations carried out by means of the Software are based essentially on the data you put in. Therefore, you bear the sole responsibility for the absence of errors, the completeness and the relevance of the data to be put in by you. Moreover, you bear sole responsibility for having the results of the calculation checked and cleared by an expert, particularly with regard to compliance with applicable norms and permits, prior to using them for your specific facility. The Software serves only as an aid to interpret norms and permits without any guarantee as to the absence of errors, the correctness and the relevance of the results or suitability for a specific application.
- You must take all necessary and reasonable steps to prevent or limit damage caused by the Software. In particular, you must arrange for the regular backup of programs and data and, if applicable, carry out the updates of the Software offered by Hilti on a regular basis. If you do not use the AutoUpdate function of the Software, you must ensure that you are using the current and thus up-to-date version of the Software in each case by carrying out manual updates via the Hilti Website. Hilti will not be liable for consequences, such as the recovery of lost or damaged data or programs, arising from a culpable breach of duty by you.