


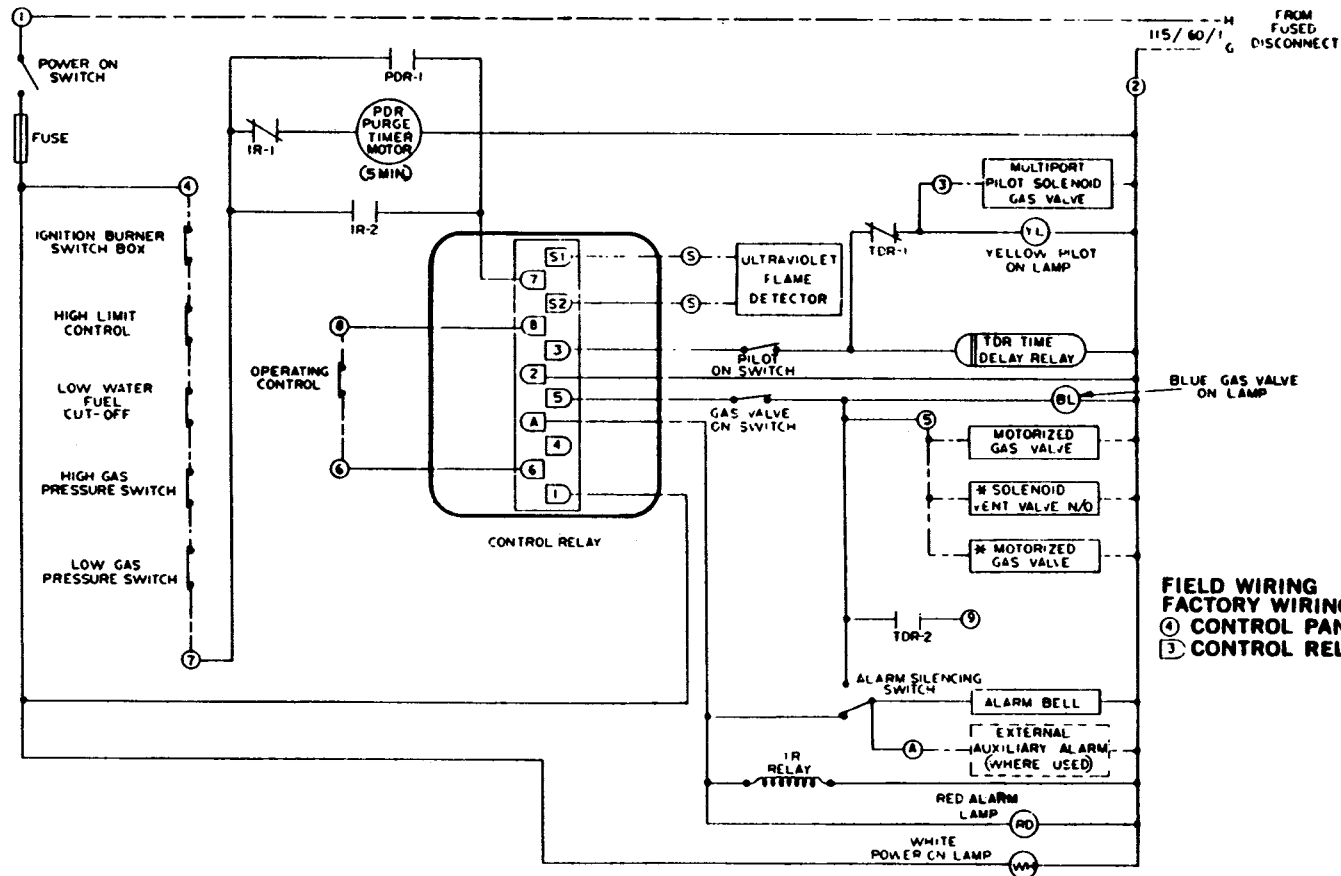

FIELD WIRING -----
FACTORY WIRING —————
 ① CONTROL PANEL TERMINAL
 ② CONTROL RELAY TERMINAL

NOTE: WHERE TWO SEPARATE COMPLETE GAS TRAINS WILL BE EMPLOYED, EACH GAS TRAIN MUST BE WIRED IN PARALLEL.

*** NOT REQUIRED FOR FACTORY MUTUAL SPECIFICATIONS.**