


# SCHEMATIC WIRING DIAGRAM

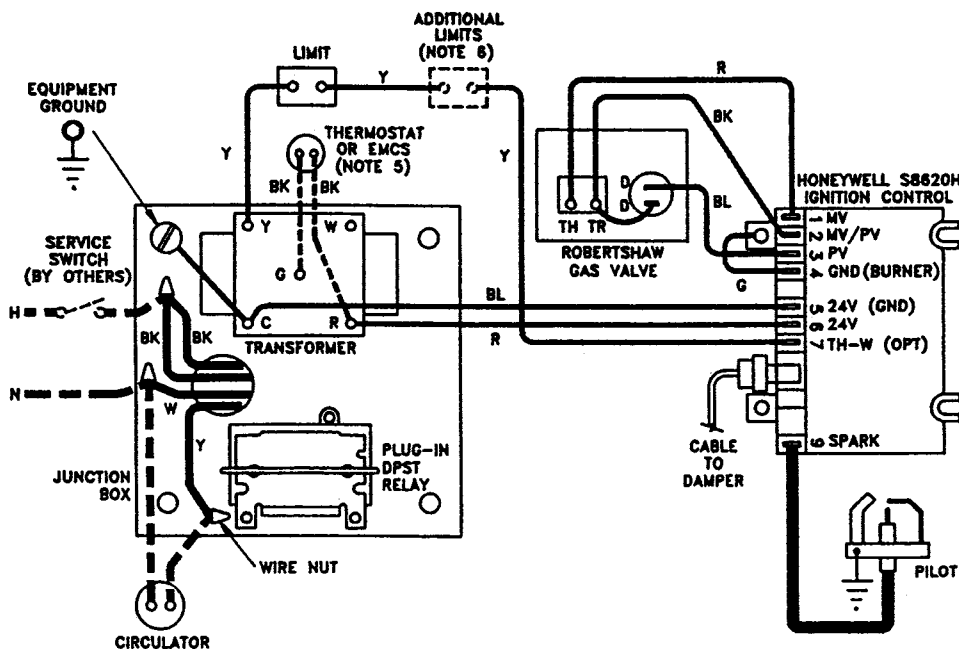


## WARNING

ELECTRICAL SHOCK HAZARD, CAN CAUSE SEVERE INJURY OR DEATH. DISCONNECT POWER BEFORE INSTALLING AND/OR SERVICING.

### NOTES:

- ALL WIRING MUST BE INSTALLED IN ACCORDANCE WITH:
  - U.S.A. - NATIONAL ELECTRICAL CODE AND ANY OTHER NATIONAL, STATE, OR LOCAL CODE REQUIREMENTS HAVING JURISDICTION.
  - CANADA - C.S.A. C22.1 CANADIAN ELECTRICAL CODE PART 1 AND ANY OTHER NATIONAL, PROVINCIAL, OR LOCAL CODE REQUIREMENTS HAVING JURISDICTION.
- ALL SAFETY CIRCUIT WIRING MUST BE:
  - U.S.A. - N.E.C. CLASS 1.
  - CANADA - C.S.A. C22.1 C.E.C. PART 1.
- IF ORIGINAL WIRE AS SUPPLIED WITH THE APPLIANCE MUST BE REPLACED, TYPE 90°C OR ITS EQUIVALENT MUST BE USED.
- REFER TO CONTROL COMPONENT INSTRUCTIONS PACKED WITH BOILER FOR APPLICATION INFORMATION.
- THERMOSTAT** - FOR SINGLE ZONE SYSTEMS, THERMOSTAT ANTICIPATOR SETTING IS 0.40 AMPS. FOR MULTIPLE ZONE SYSTEMS USING ZONE VALVES OR CIRCULATORS, REFER TO COMPONENT MANUFACTURER'S INSTRUCTIONS FOR APPLICATION WIRING AND THERMOSTAT ANTICIPATOR SETTING.  
**EMCS** - FOR EMCS CONNECTION IN PLACE OF THERMOSTAT, REFER TO EMCS INSTALLATION/OPERATING MANUAL.
- L.W.C.O., HIGH LIMIT, ETC., WIRED IN SERIES.

# LADDER WIRING DIAGRAM

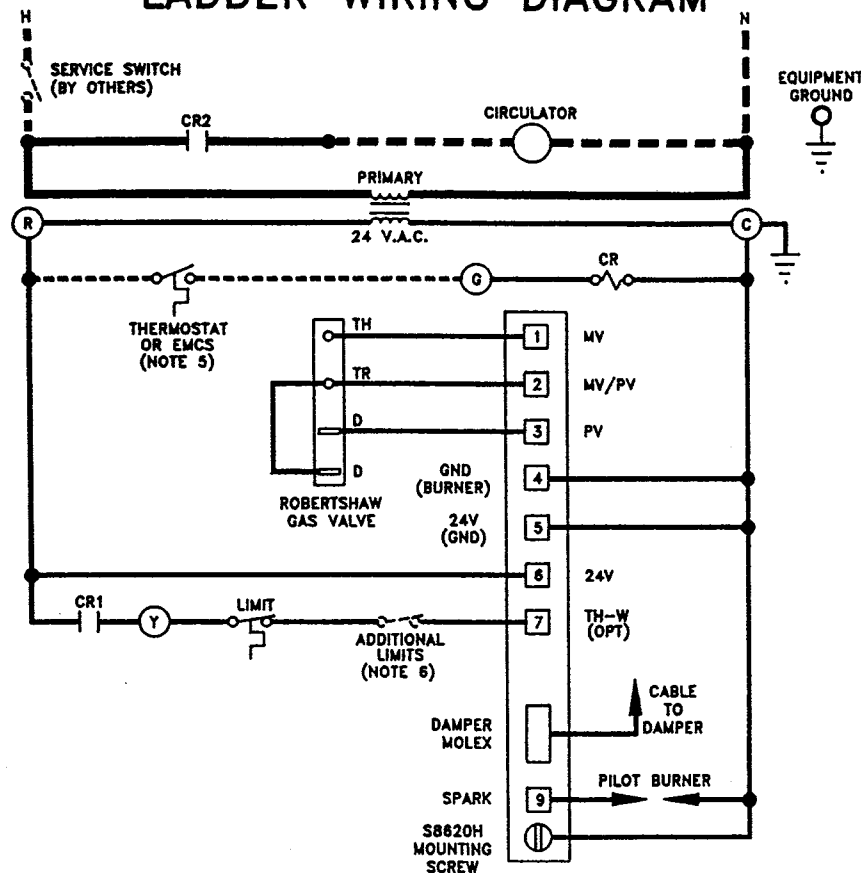

LOW VOLTAGE FIELD  
 HIGH VOLTAGE FIELD  
 LOW VOLTAGE FACTORY  
 HIGH VOLTAGE FACTORY  
 IGNITION/SENSING CABLE

NOTICE - ALL CONTACTS SHOWN WITHOUT POWER APPLIED - OFF SHELF CONDITION.

Wiring Diagram for PFG-6 thru 8

- Intermittent Ignition System, Honeywell S8620H
- Forced Hot Water

## WEIL-McLAIN

A Division of The Marley Company  
 Michigan City, Indiana 46360

PART NUMBER 550-224-047/0691WM